



GE APPLIANCES

VARIABLE REFRIGERANT FLOW HEAT PUMP SYSTEM INDOOR UNIT MWAL012NE2AA

12K
BTH/h

SUBMITTAL

Job Name:

Purchaser:

Submitted To:

Construction:

Reference:

Approval:


Date:

Submitted By:

Unit:

Drawing #:

STANDARD CASSETTE (3X3)

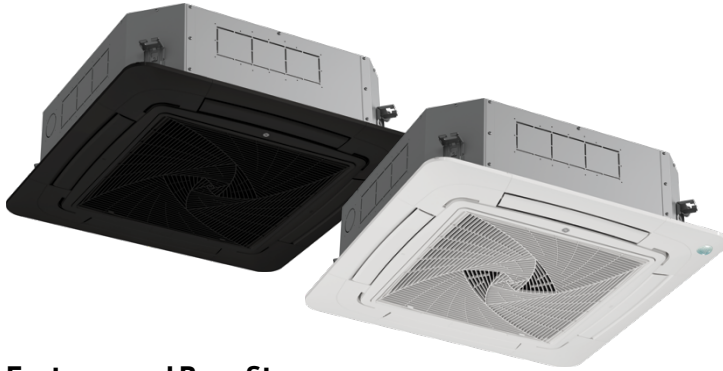

Features and Benefits

- 4-way air flow with stylish panel design.
- Equipped with a built-in occupancy sensor for automatic comfort.
- Includes a factory provided knockout for fresh air inlet to cassette unit.
- Simplified installation and faster, more reliable system communication with 2-Core, Non-Polar Communication.
- Electronic expansion valve with automatic control.
- Panel available in black or white finish.

Specifications

ODU	Marketing Model Name	MWAL012NE2AA
	Nominal Capacity (Btu/h)	12,000
	Dimension: H x W x D (in.)	9-11/16 x 33-1/16 x 33-1/16
	Net Weight (lbs)	52.9
	Sound Level (dBA)	49/47/46/44/43/42/41
	Heating Capacity (Btu/h)	13,000
Electrical	Voltage (V / Ø / Hz)	208-230/1/60
	Minimum Circuit Ampcity (MCA)	1.56
	Maximum Overcurrent Protection	15
	Running Current, Cooling	1.25
	Running Current, Heating	1.25
Fan	Type	Centrifugal
	Motor Type	BLDC
	Motor Output	100
	Number of Speeds	7
	Airflow Rate, CFM (H/M/L)	753/739/671
	Airflow Rate, m ³ /h (H/M/L)	1280/1255/1140
Refrigerant and Piping	Refrigerant Type/Charge (oz.)	R32 / -
	Liquid Pipe O.D. (in)	1/4
	Gas Pipe O.D. (in)	1/2

For more information visit us:

[GEAppliancesAirAndWater.com](https://www.GEAppliancesAirAndWater.com)


©Copyright 2026 GE Appliances, a Haier Company. GE is a trademark of the General Electric Company. Manufactured under trademark license. GE Appliances has a policy of continuous improvement of its products and reserves the right to change materials and specifications without notice.



GE APPLIANCES
a Haier company

AIR&WATER
SOLUTIONS

Dimensions (unit: in.)

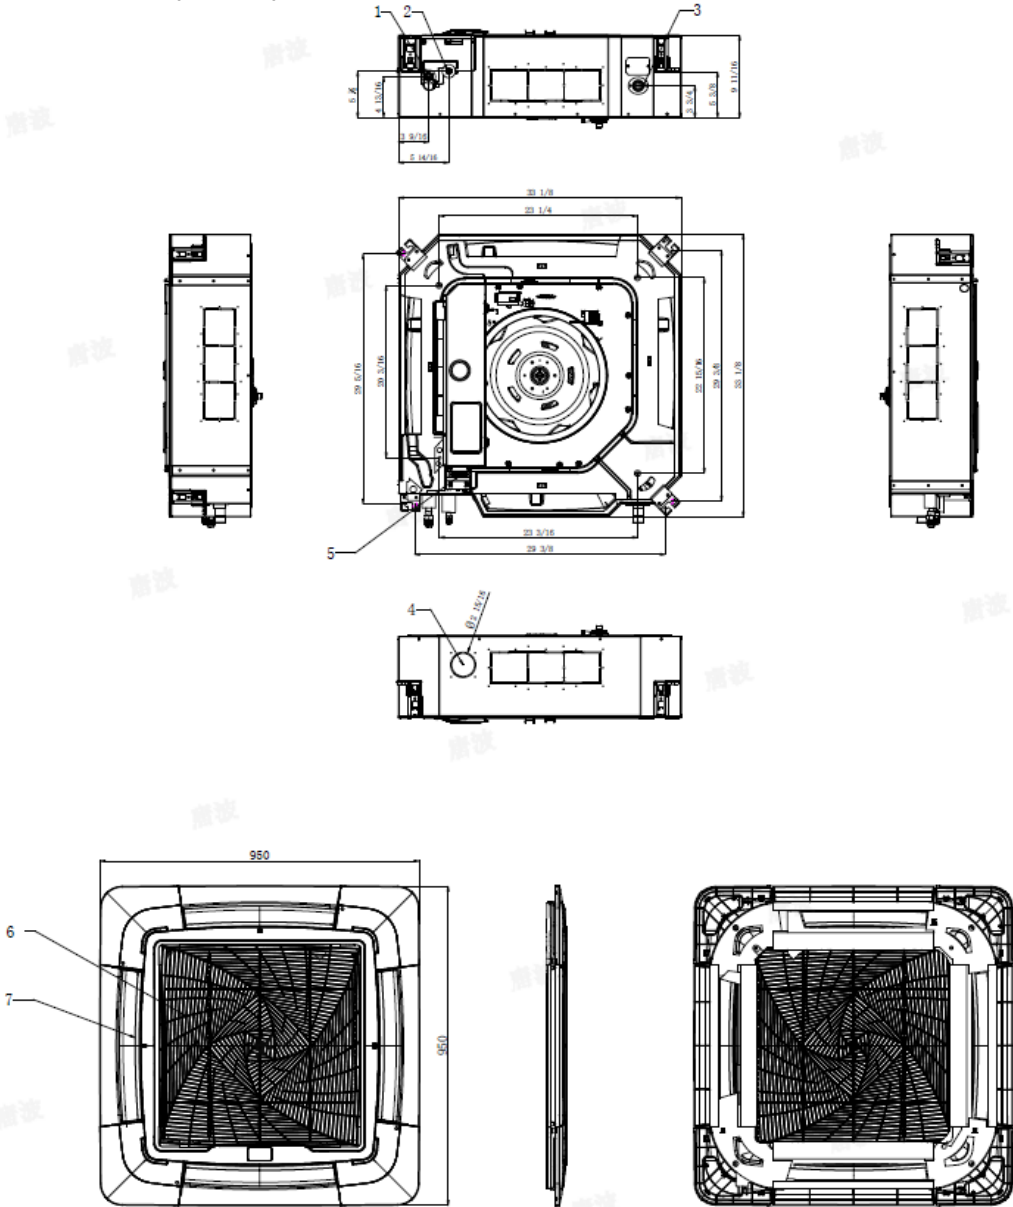

No.	Parts Name	Notes
1	Gas pipe connection	
2	Liquid pipe connection	
3	Drain pipe connection	
4	Fresh air inlet	
5	PQ line connection Power supply connection	
6	Air inlet grille	
7	Air outlet	

SUBMITTAL REVISION HISTORY

05-08-26: Submittal release.